



Asbestos Register

Blue Mountains City Council maintains asbestos registers (“registers”) and asbestos management plans (“plans”) relating to each of the buildings owned or occupied by the Council. The registers and plans record information about the existence and location of any known or presumed asbestos containing materials (“ACM”) within those buildings.

The Council’s governing body has adopted the Council’s corporate [asbestos-registers]Asbestos Policy, which is available on our website.

The registers and plans are in two forms. First, the Council maintains a corporate asbestos register and a corporate asbestos management plan. Second, the Council has prepared individual registers and individual plans for each building that contains or may contain ACM. Hardcopies of those individual registers and plans are held in the building concerned.

Whenever work is carried out on a Council building the hardcopy register and the hardcopy plan are each amended by hand, as required. This action ensures that Council employees or contractors who work from time to time within that building have access to accurate information about the ACM that it contains or may contain.

The electronic versions of each of the corporate plans and registers, and of the plans and registers for individual buildings, are periodically updated. However, the key documents are the hardcopy registers and the hardcopy plans for each building which must be inspected before any work is carried out on that building.

NOTES:

- (1) The Council’s electronic registers and plans are valid as dated, and ARE NOT to be relied upon as definitive records and ARE NOT to be used for reference purposes for any construction, demolition, maintenance or any other onsite works. IN ALL CASES, the onsite hardcopy building specific asbestos register and building specific asbestos management plan MUST BE CONSULTED prior to the commencement of physical works on the building concerned. While the electronic versions of the Council’s registers and plans provide guidance concerning the presence or possible presence of ACM it is the onsite hardcopy registers and plans which will remain up to date.
- (2) The Council’s electronic registers and plans relate to Council owned or managed buildings. The electronic registers and plans do not relate to structures (such as picnic shelters, bus shelters and other freestanding structures). Before any work is carried out on such structures the Council’s Hazardous Materials Team (“HMT”) MUST BE CONSULTED. The HMT may be contacted at council@bmcc.nsw.gov.au. The HMT will provide information concerning any ACM that may be present in the structure concerned.

Further information: Further information on safe asbestos management may be obtained by contacting Councils Hazardous Materials Management Team at council@bmcc.nsw.gov.au.





Asbestos Register

&

Management Plan

Asbestos Response Team

Springwood Early Childhood Centre,
169-171 Macquarie Road, SPRINGWOOD NSW 2777


Asbestos Register and Management Plan

| | | | |
|------------------------|---|---|--|
| Policy Ref. No: | 25132 | Staff Consultative Committee Endorsement Date: | N/A |
| HPE Record No: | RAR-58 | PCT Endorsement Date: | N/A |
| Distribution: | Onsite Delivery | ELT Meeting Date: | N/A |
| Status: | Approved | | |
| Scope: | Tenants, Facility Users, Community | Governing Policy: | Asbestos Management Policy |
| Lifespan: | 5 years or following legislative change | Responsible Directorate/Group: | Property and Commercial Services |
| Next review: | 2 years from adoption | Contact Position: | Program Leader Hazardous Materials Team |



Version History

| Version | Adoption Date | Reason for Change |
|---------|---------------|-------------------|
| 1 | January 2019 | Initial Version |
| 1.1 | July 2019 | Register Review |

Asbestos Register

| Licence Number | Address | Asset Type | Property Owner | Activity Level | | |
|---|--|-----------------------------------|----------------------------|---|-----------------------------|-----------------------------|
| SPRINGWOOD NSW 2777 | | | | | | |
| RAR-58 | Springwood Early Childhood Centre, 169-171 Macquarie Road SPRINGWOOD | Welfare services | The Crown | Risks on site | | |
| Cottage | | | | | | |
| Status: Active | | | | | | |
| | Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date |
| | 1273 | 19/12/2014 | | Yes | 26-Jun-2019 | 26-Jun-2024 |
|  | Accessibility | Material | Extent | Result | | |
| | Accessible | Fibrous Cement Sheeting | 7m2 | Chrysotile | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed | |
| | Non Friable | Sealed | RA04 - Very Low | No Remedial Action - Reinspect Periodically | No | |
| Specific Location | | | | | | |
| Springwood Early Childhood Health Centre - External Entrance Area Ceiling Lining | | | | | | |
| Additional Comments | | | | | GPS Lat,Long | |
| Sample - 25132-52-1 | | | | | | |

Asbestos Register

| | | | | | | |
|---|----------------------|-----------------------------------|---|------------------------|-----------------------------|-----------------------------|
|  | Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date |
| | 1276 | 19/12/2014 | | Yes | 26-Jun-2019 | 26-Jun-2024 |
| | Accessibility | Material | Extent | Result | | |
| | Accessible | Fibrous Cement Sheeting | 20m2 | Assumed Positive | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed | |
| Non Friable | Sealed | RA04 - Very Low | No Remedial Action - Reinspect Periodically | No | | |
| Specific Location | | | | | | |
| Springwood Early Childhood Health Centre - External Eaves Linings | | | | | | |
| Additional Comments | | | | | | GPS Lat,Long |
| Sample - Similar to 25132-52-1 | | | | | | |
|  | Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date |
| | 1282 | 19/12/2018 | | Yes | 26-Jun-2019 | 26-Jun-2020 |
| | Accessibility | Material | Extent | Result | | |
| | Accessible | Bituminous backing board | .25m2 | Chrysotile | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed | |
| Non Friable | Sealed | RA03 - Low | Remove During Refurb or Maintenance | Yes | | |
| Specific Location | | | | | | |
| Springwood Early Childhood Health Centre - External Entrance Area Eastern Wall Cabinet Electrical Backing Board | | | | | | |
| Additional Comments | | | | | | GPS Lat,Long |
| Sample - 25132-52-3 | | | | | | |

Asbestos Register

| Status: Closed | | | | | | | |
|----------------|---|-----------------------------------|----------------------------|--|-----------------------------|-----------------------------|--|
| | Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date | |
| | 1278 | 19/12/2014 | 19/12/2014 | Yes | | | |
| | Accessibility | Material | Extent | Result | | | |
| | Inaccessible | Fibreboard | | No Asbestos identified | | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed | | |
| | | | | No Action Required - No ACM Identified | | | |
| | Specific Location | | | | | | |
| | Springwood Early Childhood Health Centre - External Entrance Area Broom Cupboard Wall Cladding | | | | | | |
| | Additional Comments | | | | | GPS Lat,Long | |
| | Sample - 25132-52-2 | | | | | | |
| | Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date | |
| | 1280 | 19/12/2014 | 26/06/2019 | Yes | 26-Jun-2019 | | |
| | Accessibility | Material | Extent | Result | | | |
| | | Fibreboard | | No Asbestos identified | | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed | | |
| | | | | No Action Required - No ACM Identified | | | |
| | Specific Location | | | | | | |
| | Springwood Early Childhood Health Centre - External Entrance Area Broom Cupboard Ceiling and Shelf Lining | | | | | | |
| | Additional Comments | | | | | GPS Lat,Long | |
| | Sample - ART51 | | | | | | |

Asbestos Register

| | | | | | | |
|----------------------------|--|-----------------------------------|----------------------------|--|-----------------------------|-----------------------------|
| 1284 | Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date |
| | | 19/12/2014 | 19/12/2014 | Yes | | |
| | Accessibility | Material | Extent | Result | | |
| | | Window putty | | No Asbestos identified | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed | |
| | | | | No Action Required - No ACM Identified | | |
| | Specific Location | | | | | |
| | Springwood Early Childhood Health Centre - External - Window Frames – Window Putty | | | | | |
| Additional Comments | | | | | GPS Lat,Long | |
| Sample - 25132-52-4 | | | | | | |
| 1285 | Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date |
| | | 19/12/2014 | 19/12/2014 | Yes | | |
| | Accessibility | Material | Extent | Result | | |
| | | Mastic | | No Asbestos identified | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed | |
| | | | | No Action Required - No ACM Identified | | |
| | Specific Location | | | | | |
| | Springwood Early Childhood Health Centre - External - Western Perimeter Wall – Expansion Joints – Mastic | | | | | |
| Additional Comments | | | | | GPS Lat,Long | |
| Sample - 25132-52-5 | | | | | | |

Asbestos Register

| Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date | |
|---------------------|--|----------------------------|-----------------|--|----------------------|--|
| 1286 | 19/12/2014 | 26/06/2019 | Yes | | | |
| | Accessibility | Material | Extent | Result | | |
| | Accessible | Masonite | | No Asbestos identified | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed | |
| | | | | No Action Required - No ACM Identified | | |
| | Specific Location | | | | | |
| | Springwood Early Childhood Health Centre - Internal - Above doorway Springwood Early Childhood Health Centre - Internal - Above Doorways throughout – Panels | | | | | |
| Additional Comments | | | | | GPS Lat,Long | |
| | | | | | | |
| Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date | |
| 1287 | 19/12/2014 | 19/12/2014 | Yes | | | |
| | Accessibility | Material | Extent | Result | | |
| | | Light brown linoleum | | No Asbestos identified | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed | |
| | | | | No Action Required - No ACM Identified | | |
| | Specific Location | | | | | |
| | Springwood Early Childhood Health Centre - Internal - Kitchen – Linoleum | | | | | |
| Additional Comments | | | | | GPS Lat,Long | |
| | | | | | | |

Asbestos Register

Status: Under review

| Ref No. | Date Identified | Clearance Cert Date | Onsite Register | Last Inspection Date | Next Inspection Date |
|--|----------------------|-----------------------------------|------------------------|------------------------|-----------------------|
| 3322 | 19/12/2014 | | Yes | | |
| | Accessibility | Material | Extent | Result | |
| | Inaccessible | | | | |
| | Friability | Sealed / Surface Treatment | Risk Assessment | Control Actions | Labels Affixed |
| | | | | Investigate | |
| Specific Location | | | | | |
| Springwood Early Childhood Health Centre - Hallway Storage Cupboards | | | | | |
| Additional Comments | | | | | GPS Lat,Long |
| | | | | | |

Risk Matrix

| | | |
|--|---|---|
| Reference Number | Reference number as per the Asbestos Database, may also be used to label the floorplan (If no number is identified then a generic number is to be created on spot) | |
| Sample number | Sample number from previous reports that are available | |
| Int / Ext Floor Specific Location | Detail where in the building the material is referring too. (eg. southern wall male bathroom) | |
| Material Type | Details what type of material it is (eg. fibre cement sheeting, Plasterboard) | |
| Extent | Detail how many square metres are present | |
| Analysis | Detail what type of asbestos is present (Chrysotile, Amosite or Crocidolite) | |
| Variable | Score | Example of Score |
| Accessibility | | |
| Accessible | 2 | The material is located in frequently accessible areas with potential for disturbance or the material is prone to mechanical disturbance due to routine building activity and/or maintenance |
| Non-Accessible | 1 | Routine accessibility is unlikely to cause significant deterioration, the material is located in areas with minimal or no disturbance potential or the material is adequately sealed |
| Condition | | |
| Good | 1 | <ul style="list-style-type: none"> Firmly bonded Painted or sealed Without visible cracks or damage Without associated debris Without weathering or deterioration |
| Fair | 2 | <ul style="list-style-type: none"> Unpainted or unsealed Subject to minor or infrequent weathering Friable but encapsulated (e.g. pipe lagging wrapped in plastic) Without significant visual damage or deterioration (e.g. minor cracks or frayed edges) |
| Poor | 3 | <ul style="list-style-type: none"> Un-bonded Unstable Significant damage Friable and damaged Fire damaged Visible debris Material is inaccessible Area or room is inaccessible but it is assumed to have ACMs within it |
| Friability of Asbestos | | |
| Friable | 3 | Detail the classification of the asbestos |
| Non-Friable | 1 | |
| Surface Treatment | | |
| Sealed | 1 | Refers to whether or not the material is encapsulated with a sealant such as paint, wall paper, etc. concealing its exposed surfaces. Enclosed sprays/lagging/board. (painted or encapsulated with no exposed edges) |
| Partially Sealed | 2 | Bare ACM or encapsulated lagging/spray. (Partially painted or encapsulated) |
| Unsealed | 3 | Unsealed lagging/spray/loose asbestos. (no evidence of paint or encapsulation methods used) |

Risk Assessment

The Material Assessment score is calculated by adding the parameters above. The potential for releasing fibres is detailed below.

| Material Assessment Score | Risk Category | Fibre Release Potential |
|---------------------------|---------------|-------------------------|
| 10 or higher | A1 | High |
| 8 – 9 | A2 | Medium |
| 6 – 7 | A3 | Low |
| 5 or lower | A4 | Very Low |
| Nil | A5 | No Risk |

| Risk Category | Control Descriptor / Control Action |
|---------------|---|
| A1 | (CA02) Restrict Access & Remove as Reasonably Practicable |
| | <ul style="list-style-type: none"> Friable or poorly bonded to substrate, located in accessible areas. Severely water damaged or unstable Further damage or deterioration likely Asbestos debris and stored asbestos in reasonably accessible areas |
| A2 | (CA01) Enclose, Encapsulate or Seal by Licensed Contractor - Re Inspect Periodically |
| | <ul style="list-style-type: none"> Damaged material in reasonably accessible areas Poorly bonded to substrate, with bonding achievable. Possibility of disturbance through contact Possibility of deterioration through weathering |
| A3 | (CA06) Remove During Refurbishment or Maintenance. Enclose, Encapsulate or Seal by General Maintenance Contractors , Re Inspect Periodically |
| | <ul style="list-style-type: none"> Asbestos debris or stored material in rarely accessed areas Further disturbance or damage unlikely , other than during maintenance or service Asbestos friction materials, gaskets and brake linings |
| A4 | (CA04) No remedial Action Re Inspect Periodically |
| | <ul style="list-style-type: none"> Firmly bonded to substrate and readily visible for inspection Inaccessible and fully contained Stable and damage unlikely |
| A5 | (CA05) No Action Required - No ACM Identified |
| | <ul style="list-style-type: none"> ACM incident cleared |

Labels Affixed

| | |
|-----|---------------------------------------|
| Yes | Labels are present on the asbestos |
| No | No labels are present on the asbestos |

Additional comments

Refers to any other relevant comments that may assist with the future management of the material. You may make reference to lifting all picture frames whilst completing inspection.

Next Inspection Due date

Maximum 5 Year from current inspection date

TEST REPORT

December 19, 2014

Blue Mountains City Council

Locked Bag 1005
KATOOMBA NSW 2780

Your Reference: Blue Mountains City Council – Round 2
Job Number: 25132

Attention: Steve Kitching

Dear Steve,

In accordance with your instructions, Airsafe tested samples from the above site for asbestos content.

The following samples were processed on the dates indicated.

| | |
|----------------------------------|-------------------|
| Samples: | 354 Sample's |
| Date of Sampling: | 30/10/14-03/12/14 |
| Date of Analysis: | 01/11/14-10/12/14 |
| Date of Preliminary Report Sent: | Not Issued |

The results and associated quality control are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE OHC PTY LIMITED



Kieran White
Manager

PROJECT: Blue Mountains City Council – Round 2

JOB NO: 25132

| | | | |
|-------------|---|---|--|
| 25132-48-11 | 156 Megalong Street, Leura – Internal – Nursery – Toilet – internal wall cladding | 8x7x3mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-50-1 | 23 Gates Avenue, Katoomba – External – Laundry – external wall cladding | 54x30x5mm fibreboard fragment | Chrysotile asbestos detected Crocidolite asbestos detected |
| 25132-50-2 | 23 Gates Avenue, Katoomba – External – Window Frames – window putty | 4x3x3mm window putty fragment | No asbestos detected |
| 25132-50-3 | 23 Gates Avenue, Katoomba – External – Sub-floor – packer within structural beams | 13x8x3mm fibrous cement sheet fragment | Chrysotile asbestos detected Crocidolite asbestos detected |
| 25132-50-5 | 23 Gates Avenue, Katoomba – Internal – Kitchen – internal wall cladding | 2x2x1mm fibrous cement sheet fragment | Chrysotile asbestos detected Amosite asbestos detected Crocidolite asbestos detected |
| 25132-50-6 | 23 Gates Avenue, Katoomba – Internal – Bathroom – internal wall cladding | 5x5x1mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-50-7 | 23 Gates Avenue, Katoomba – Internal – South-eastern Storeroom – internal wall batons | 2x2x1mm fibrous cement sheet fragment | Chrysotile asbestos detected Crocidolite asbestos detected |
| 25132-50-8 | 23 Gates Avenue, Katoomba – Internal – Southern Storeroom – internal wall batons | 3x2x1mm fibrous cement sheet fragment | Chrysotile asbestos detected Crocidolite asbestos detected |
| 25132-51-1 | Katoomba Community Legal Centre – External – Northern Perimeter – external wall panels | 4x3x3mm fibrous cement sheet fragment | Chrysotile asbestos detected Crocidolite asbestos detected |
| 25132-51-2 | Katoomba Community Legal Centre – External – eastern verandah – compressed flooring | 30x15x3mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-51-3 | Katoomba Community Legal Centre – External – Sub-floor – north-west area – debris on ground surface | 63x38x5mm fibrous cement sheet fragment | Chrysotile asbestos detected Crocidolite asbestos detected Amosite asbestos detected |
| 25132-51-4 | Katoomba Community Legal Centre – Internal – north-eastern storeroom – ceiling lining | 3x2x1mm fibrous cement sheet fragment | Chrysotile asbestos detected Amosite asbestos |
| 25132-51-5 | Katoomba Community Legal Centre – Internal – north-eastern storeroom – internal wall cladding | 4x2x1mm fibrous cement sheet fragment | Chrysotile asbestos detected Amosite asbestos |
| 25132-51-6 | Katoomba Community Legal Centre – Internal – Archives – bulkhead lining | 9x7x1mm fibrous cement sheet fragment | Chrysotile asbestos detected Amosite asbestos |
| 25132-51-7 | Katoomba Community Legal Centre – Internal – Toilet – internal wall cladding | 5x5x1mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-51-8 | Katoomba Community Legal Centre – Internal – Kitchen – northern lower internal wall cladding | 6x4x1mm fibrous cement sheet fragment | Chrysotile asbestos detected Amosite asbestos |
| 25132-52-1 | Springwood Early Childhood Health Centre – External – Entrance Area – ceiling lining | 7x4x1mm fibrous cement sheet fragment | Chrysotile asbestos detected |

PROJECT: Blue Mountains City Council – Round 2

JOB NO: 25132

| | | | |
|------------|--|---|---|
| 25132-52-2 | Springwood Early Childhood Health Centre – External – Entrance Area – Broom Cupboard – internal wall cladding | 6x3x1mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-52-3 | Springwood Early Childhood Health Centre – External – Entrance Area – Eastern Wall – Cabinet – electrical backing board | 3x2x2mm bituminous backing board fragment | Chrysotile asbestos detected |
| 25132-52-4 | Springwood Early Childhood Health Centre – External – Window Frames – window putty | 38x10x9mm window putty fragment | No asbestos detected |
| 25132-52-5 | Springwood Early Childhood Health Centre – External – Western Perimeter Wall – expansion joints – mastic | 45x13x5mm mastic fragment | No asbestos detected |
| 25132-53-1 | Katoomba Emergency Service Centre – Fire Control Centre – External – Entrance – awning lining | 7x4x1mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-53-2 | Katoomba Emergency Service Centre – Fire Control Centre – Internal – Disabled Toilets – ceiling lining | 6x5x1mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-53-3 | Katoomba Emergency Service Centre – Fire Control Centre – Internal – Disabled Toilets – internal wall cladding | 4x3x1mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-53-4 | Katoomba Emergency Service Centre – Workshop – External – western perimeter – access gate – external panel | 16x8x4mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-53-5 | Katoomba Emergency Service Centre – Workshop – Internal – Eastern Storeroom – internal wall cladding | 13x7x2mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-53-6 | Katoomba Emergency Service Centre – Workshop – Internal – garages – partition wall | 34x17x3mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-53-7 | Katoomba Emergency Services Centre – Transmitter Hut – Internal – internal wall cladding | 8x5x2mm fibreboard fragment | Chrysotile asbestos detected [Organic fibres detected] |
| 25132-54-1 | Valley Heights Rural Fire Service Bushfire Station – External – Transmitter Tower – compressed panels | 8x5x2mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-54-2 | Valley Heights Rural Fire Service Bushfire Station – External – lower eastern roof – membrane | 40x24x1mm waterproof membrane fragment | No asbestos detected [Organic fibres detected] |
| 25132-54-3 | Valley Heights Rural Fire Service Bushfire Station – External – Window Frames – mastic surrounding | 8x4x2mm window putty fragment | Chrysotile asbestos detected |
| 25132-54-4 | Valley Heights Rural Fire Service Bushfire Station – External – Southern Perimeter – electrical box – electrical backing board | 3x3x2mm bituminous backing board fragment | Chrysotile asbestos detected |
| 25132-54-5 | Valley Heights Rural Fire Service Bushfire Station – Internal – Kitchen – southern internal wall cladding | 12x5x1mm fibreboard fragment | Chrysotile asbestos detected [Organic fibres detected] |
| 25132-57-1 | Katoomba Children's Cottage – External – eave linings | 7x4x1mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-57-2 | Katoomba Children's Cottage – External – north-eastern perimeter – external wall cladding | 20x13x3mm fibreboard fragment | No asbestos detected [Organic fibres detected] |
| 25132-57-3 | Katoomba Children's Cottage – Internal – ceiling space – above Laundry – debris | 63x34x1mm fibreboard fragment | No asbestos detected [Organic fibres detected] |

Certificate of Analysis – Asbestos Identification

REPORT NUMBER : 19365SpringwoodEarlyChildhood02072019AID

| | | | |
|---------------------------|-----------------------------|------------------------|------------------------------------|
| CLIENT : | Blue Mountains City Council | JOB NUMBER : | 19365 - Springwood Early Childhood |
| CLIENT CONTACT : | Jason Adams | DATE RECEIVED : | 02/07/2019 |
| CLIENT REFERENCE : | Springwood Early Childhood | DATE ANALYSED : | 02/07/2019 |
| CLIENT EMAIL : | jadams@bmcc.nsw.gov.au | REPORT DATE : | 02/07/2019 |
| CLIENT TELEPHONE : | 0413 334 101 | SAMPLE DATE : | 26/06/2019 |

Test method:

Asbestos fibre qualitative determination in bulk & soil samples at JMB Environmental Consulting Pty Ltd (JMBEC) laboratory, is conducted by polarised light microscopy, in conjunction with the dispersion staining technique. The strategies and methods used are as per AS4964(2004) and in-house SOP JMBEC D123. All results of the tests, calibrations, and records are traceable to the Australian/national standard. Accredited for compliance with ISO/IEC 17025 - Testing. NATA accreditation number 19564

| SAMPLE REFERENCE | LABORATORY REFERENCE | SAMPLE INFORMATION | SAMPLE DIMENSIONS (mm) / WEIGHT (g) | ANALYTICAL RESULT |
|------------------|---|--------------------|-------------------------------------|-------------------|
| ART 51 | 19365 - Springwood Early Childhood-ART 51 | Chip Board | 0.10 | NAD, ORG |

Legend:

NAD: No asbestos detected
NADRL: No asbestos found, at the reporting limit (0.1 g/kg / 0.01%)
CHR: Chrysotile asbestos detected
AMO: Amosite asbestos detected
CRO: Crocidolite asbestos detected
ORG: Organic fibre detected
SMF: Synthetic mineral fibre detected
UMF: Unknown mineral fibre detected



Approved analyst

Name : Imran Javed

Signature :



Approved Signatory

Name : James Breslin

Signature :



Glossary and notes:

- AS4964 recommends minimum sample sizes for all materials. In particular, soil sample volume is 50-100ml (approximately 50 to 250g). It is the sampling party's responsibility to meet this recommendation.
- Other analytical reporting limits outside of mentioned scope is not cover by NATA accreditation; such as NEPM WA.
- JMBEC require receipt of all samples under a chain of custody, however JMBEC except no responsibility for the sampling method/location/transportation or packaging of samples from external sources.
- *No asbestos detected by Polarized Light Microscopy in conjunction with Dispersion staining techniques. The client is advised to obtain a further result from an independent confirmatory analytical technique due to the nature of sample, e.g. scanning electron microscopy (SEM).



Table of Contents

| | |
|---|----|
| 1. Executive Summary..... | 4 |
| 2. Scope..... | 4 |
| 3. Background | 5 |
| 4. How to use this report | 5 |
| 5. Inaccessible Areas | 6 |
| 6. Risk Assessment Criteria | 6 |
| 7. Control Options..... | 6 |
| 8. Responsibilities | 7 |
| I. Controller of Premises | 7 |
| II. Special Responsibilities - Asbestos | 8 |
| III. Employers | 9 |
| IV. Employees & Contractors | 9 |
| V. Asbestos Consultant | 10 |
| VI. Asbestos Removalists..... | 10 |
| 9. Awareness & Training..... | 11 |
| 10. Signage..... | 11 |
| 11. Review..... | 12 |
| 12. Emergency Procedures | 12 |
| Figure 1 Emergency Procedures Chart | 13 |
| 13. Legislation, Codes & Standards..... | 14 |
| 14. Terms & Definitions | 15 |

1. Executive Summary

The materials identified in this report have been assessed as **A3 and A4** and must be managed in full accordance with the Asbestos Management Plan.

| Risk Category | Control Descriptor |
|---------------|--|
| 1 | Restrict Access & Remove |
| | <ul style="list-style-type: none">• Friable or poorly bonded to substrate, located in accessible areas.• Severely water damaged or unstable• Further damage or deterioration likely• Asbestos debris and stored asbestos in reasonably accessible areas |
| 2 | Enclose, Encapsulate or Seal by Licensed Contractor - Re Inspect Periodically |
| | <ul style="list-style-type: none">• Damaged material in reasonably accessible areas• Friable or poorly bonded to substrate, with bonding achievable.• Possibility of disturbance through contact• Possibility of deterioration through weathering |
| 3 | Remove During Refurbishment or Maintenance. Enclose, Encapsulate or Seal by General Maintenance Contractors , Re Inspect Periodically |
| | <ul style="list-style-type: none">• Asbestos debris or stored material in rarely accessed areas• Further disturbance or damage unlikely , other than during maintenance or service• Asbestos friction materials, gaskets and brake linings |
| 4 | No remedial Action Re Inspect Periodically |
| | <ul style="list-style-type: none">• Firmly bonded to substrate and readily visible for inspection• Inaccessible and fully contained• Stable and damage unlikely |
| 5 | No Action Required - No ACM Identified |

Should ACM be disturbed, the area must be isolated and an independent assessment by an Occupational Hygienist must be undertaken coupled with airborne asbestos air monitoring.

It is expressly prohibited for any person other than a duly authorised BMCC Employee or engaged contractor to remove, handle, treat, dispose of or disturb ACM on a BMCC owned asset. Should maintenance works be required on ACM, or disturbed ACM, is identified then BMCC must be advised immediately on [4780 5000](tel:47805000)

2. Scope

This Asbestos Management Plan has been developed by Blue Mountains City Council and in full accordance with NSW Work Health & Safety Regulation Chapter 8 Part 8.2 Section 429: *A person with management control of the workplace must ensure a written asbestos management plan for the workplace is prepared and must be made readily accessible.*



3. Background

The information in this report has been developed based on the data within an Asbestos Register provided by:

Company: Hazardous Materials Team BMCC

Report N°: 18/239527

Date of Report: 26/6/2019

The site is located: Springwood Early Childhood Centre, 169-171 Macquarie Road, SPRINGWOOD NSW 2777

4. How to use this report

This report is an **Asbestos Register (AR)** and **Asbestos Management Plan (AMP)** for the location specified at Section 3 of this report. It covers the management of Asbestos Containing Materials (ACM) which has been identified via an inspection process undertaken by the company detailed in Section 3 and this AMP must be read in conjunction with the above mentioned Asbestos Register.

The purpose of this AMP is to ensure full compliance with the legislative and regulatory requirements intrinsic to Asbestos Management in NSW, including compliance with NSW Code of Practice on the Safe Management of Asbestos in the Workplace.

The Site Manager responsible for the building surveyed must retain this document on site at all times.

The AMP shall be made available to any person with a legitimate rationale for accessing the document.

It is a requirement that any activity at this location involving the removal or encapsulation of any material listed in the Asbestos Register is recorded and signed off (Refer to the Asbestos Control Log in the Asbestos Register).

All Asbestos Related works must be consulted with Blue Mountains City Council prior to any works being undertaken in order to ensure that the works are completed to a satisfactory standard in accordance with relevant codes, standards and guidelines.

Any queries regarding the interpretation and/or implementation of this Management Plan should be directed to BMCC.



5. Inaccessible Areas

The areas detailed below should be assumed to be contaminated with elevated levels of asbestos.

NIL

Controls for contaminated dust to be managed in-situ must be applied in these areas, and any vents, cracks or holes that connect the occupied space into the ceiling cavity should be sealed upon identification.

Should hazardous/potentially hazardous materials be identified during renovation and/or demolition activities, material must be sampled for expert identification and further advice.

6. Risk Assessment Criteria

It is a legal requirement to identify hazards in the workplace. An assessment of the potential risk of harm to health and safety arising from the identified hazards must also be undertaken. Such a risk assessment assists in identifying and selecting appropriate management options.

Risk levels associated with the identified hazardous building materials have been assessed using the following criteria:

- Product type;
- Extent of damage or deterioration;
- Surface treatment; and
- Asbestos type.

The results of the risk assessment are documented in the Asbestos Register (Section 5). Appropriate management options have been selected on the basis of the level of risk determined for each hazardous material identified.

7. Control Options

The following hierarchy of controls should be consulted when implementing control measures to eliminate the risks arising from hazardous materials.

- Elimination/removal;
- Isolation/enclosure/sealing;
- Engineering Controls;
- Safe Work Practices (administrative controls); and
- Personal Protective Equipment.

A combination of these controls may be required in order to manage hazardous materials.

In consideration of the Hierarchy of Controls, preferential consideration must be given to removing hazardous materials during renovation, refurbishment and maintenance activities etc. where removal is practicable.

Areas of a workplace that contain ACM including plant, equipment and components should be signposted with appropriate warning signs to ensure that hazardous materials are not unknowingly disturbed without the correct precautions being implemented.

Signage should be placed at all entrances to the work areas where ACM is present and must conform to Australian Standard 1319-1994 *Safety Signs for the Occupational Environment*. The number of labels and the location of signage are to be determined by a competent person and may take into consideration the usage of areas and public access.



8. Responsibilities

Responsibilities of parties involved in the management of ACM are detailed below. It must be noted that this is not an exhaustive list and reference must be made to pertinent legislation, Codes of Practice and standards identified in **Section 14**.

I. Controller of Premises

Under *Work Health and Safety Regulation 2011*, management responsibilities and workplace obligations fall upon the following groups:

- Person in Control of Business or Undertaking (PCBU).
- Person with Management or Control (PWMC).
- Person Carrying out Demolition or Refurbishment Work.
- Under the Work Health and Safety Regulations 2011, the above mentioned group must:
- Identify any foreseeable hazard arising from the premises that has the potential to harm the health or safety of any person accessing, using or egressing from the premises.
- Identify hazards arising from the layout and condition of the premises and the presence of materials containing asbestos.
- Ensure that hazards are identified during any design of the premises and before the premises are provided for use as a place of work.
- Assess the risk of harm to the health or safety of any person arising from a hazard.
- Eliminate or control any risk to the health or safety of any persons accessing, using or egressing the premises that arise from the premises.
- Ensure all measures adopted to eliminate or control risks are properly used and maintained.
- Review risk assessments.
- Provide other persons with the information necessary to fulfil their responsibilities in identifying hazards and assessing, eliminating and controlling the associated risks.
- Provide employers with information on foreseeable hazards, assessments of risks that have not been eliminated by the controller, risk control measures and any measures an employer may need to adopt to control risk.



II. Special Responsibilities - Asbestos

Under the Code of Practice *How to Manage and Control Asbestos in the Workplace 2019* persons with control of premises used as a workplace have a duty of care to:

- Develop, implement and maintain an Asbestos Management Plan.
- Investigate the premises for the presence/possible presence of asbestos containing materials. This responsibility may not be abdicated to the Contractor.
- Develop and maintain a register of identified asbestos containing materials, including details of the location and condition of asbestos materials, risk assessments and control measures.
- Assess the condition of any asbestos containing materials that are found and the associated asbestos risks.
- Develop measures to remove asbestos materials or minimise the risks and prevent exposure.
- Ensure control measures are implemented as soon as possible and are maintained as long as asbestos materials remain in the workplace.
- Consult with any person who may be affected by the presence of asbestos materials (e.g. building occupants, neighbours and/or all relevant contractors).

The *Work Health and Safety Regulations 2011* and Safe Work Australia Codes of Practice require full consultation, information-sharing and involvement by everyone in the workplace (including employers, workers, contractors and others) throughout the process of identifying asbestos materials, developing an Asbestos Materials Management Plan, assessing risks and developing and implementing control measures.

Under the Code of Practice *How to Safely Remove Asbestos 2019* any person with control who commissions asbestos removal is responsible for the following:

- Ensuring an asbestos removalist carries out the removal of asbestos containing materials.
- Nominating person(s) to liaise with the asbestos removalist.
- Requesting asbestos removal licence details from the asbestos removalist if such a licence is required for the removal being undertaken.
- Establishing an Asbestos Register before asbestos removal commences.
- Providing the asbestos removalist with a copy of the site Asbestos Register before removal commences.

If asbestos containing materials are to be removed, the Code of Practice *How to Safely Remove Asbestos 2019* requires full consultation, information sharing and involvement by everyone in the workplace, including employers, workers and contractors at each step of the removal process using established consultative mechanisms. Persons in adjoining properties that might also be affected by the removal must also be consulted.



III. Employers

Under the *Work Health and Safety Regulations 2011* employers must take reasonable care to identify any foreseeable hazard that may arise from the conduct of the employers undertaking and that has the potential to harm the health or safety of an employee or any other person legally at the employer's place of work. In particular the employer must take reasonable care to identify hazards arising from, but not limited to, work practices and work systems, repair, maintenance, dismantling and disposal of plant, hazardous substances and the presence of hazardous materials installed in a place of work, the condition of a place of work and the physical working environment including exposure to a contaminated atmosphere.

An employer must ensure that effective procedures are in place and implemented to identify hazards including, but not limited to, those present immediately prior to using the premises for the first time as a place of work, before and during the installation, erection, commissioning or alteration of plant in a place of work and whilst work is being carried out.

An employer must assess the risk of harm to the health or safety of an employee of the employer, or any other person legally at the employer's place of work, arising from any hazard identified.

An employer must eliminate any reasonably foreseeable risk to the health or safety of an employee of the employer, or any other person legally at the employer's place of work, that arises from the conduct of the employers undertaking. If it is not reasonably practicable to eliminate the risk, the employer must control the risk.

An employer must ensure that all measures (including procedures and equipment) that are adopted to eliminate or control risks to health and safety are properly used and maintained.

An employer must ensure that each new employee receives induction training that covers, but is not limited to, workplace arrangements for management of occupational health and safety, health and safety procedures relevant to the employee including the use and maintenance of risk control measures, and accessing health and safety information required under the *Work Health and Safety Regulations 2011*.

Particular provisions also apply to construction processes where hazardous materials exposure may occur and lead processes (refer to the *Work Health and Safety Regulations 2011*).

IV. Employees & Contractors

Under the *Work Health and Safety Regulations 2011* an employee must, while at work, take reasonable care for the health and safety of people who are at the employee's place of work and who may be affected by the employee's acts or omissions at work. An employee must also, while at work, cooperate with his or her employer or other person so far as is necessary to enable compliance with any requirement under the *Work Health and Safety Act 2011* or *Regulations* imposed in the interests of health, safety and welfare on the employer or any other person.

Employees and contractors must not carry out any work that may disturb ACM without referring to the site **Asbestos Register** and **Asbestos Management Plan**.



V. Asbestos Consultant

The Asbestos Consultant is a competent person with appropriate qualifications, training and experience in the identification, assessment and management of asbestos materials.

The Consultant is to act as an independent advisor to the Site Manager and /or Property Owner on issues relating to the identification, assessment, management and control of ACM.

This Consultant's duties may include:

- Inspection, sampling and analysis of suspected asbestos containing materials.
- Assessing the risks posed by the identified asbestos containing materials.
- Developing appropriate procedures and controls for on-site management or removal of asbestos containing materials.
- Providing staff training sessions and/or site induction manuals.
- Preparing a technical specification (i.e. Scope of Works Report or Work Plan) for asbestos containing remediation projects.
- Tendering hazardous materials remediation projects.
- Providing technical supervision and monitoring during asbestos containing remediation.
- Conducting clearance inspections after asbestos remediation.
- Updating the sites Asbestos Register and Management Plan.

The Consultant is required to hold adequate and appropriate insurances for the work undertaken.

VI. Asbestos Removalists

The Asbestos Removalist Contractor must be a competent person with appropriate qualifications, training and/or experience in remediation of ACM. The Contractor is to hold appropriate licences and adequate insurances for the work undertaken.

The Contractor's operatives should complete and sign appropriate Risk Assessments and Safe Work Method Statements prior to work commencing.

All asbestos remediation conducted by the Contractor should comply with the requirements specified in the regulatory framework (refer to **Section 14**) and the Consultants technical specification (i.e. Scope of Works Report/Work Plan) for hazardous materials abatement.

The Contractor should develop a site specific Asbestos Removal Control Plan in consultation with their client before commencing any Hazardous Materials work. The client should receive a final copy of this plan.

The asbestos removalist must hold an appropriate asbestos removal license before being permitted to remove asbestos containing material. A Class A (friable) license is required for friable asbestos removal and a Class B (non-friable) license is required for non-friable asbestos removals >10 m². The removalist must provide their license details to their clients. Other requirements include:

- For friable asbestos removal, and removal of >10 m² of non-friable asbestos, permission to proceed with removal must be obtained from Safework NSW prior to any work commencing.
- Asbestos removal operatives to complete appropriate Risk Assessments and Safe Work Method Statements prior to work commencing.
- The asbestos removalist to develop a site specific asbestos removal control plan in consultation with their client before commencing any asbestos removal work. The client should receive a final copy of this plan.
- The Asbestos Removalist to ensure the removal is adequately supervised and carried out by competent persons in a safe manner.

9. Awareness & Training

Workers, contractors and any other persons on site who may be exposed to ACM as a result of undertaking activities on the premises must be provided with full information on the health and safety consequences of exposure to fibrous materials and appropriate control measures. The provision of this information must be recorded.

Information and training must be provided to persons who may be exposed to asbestos fibres in the workplace including workers, contractors and others. The training may include the following:

- The purpose of the training.
- The health risks associated with the ACM.
- Types, uses and likely occurrence of ACM in workplace.
- Roles and responsibilities of the trainee under the Asbestos Management Plan.
- Location, access and use of the site Asbestos Register.
- Timetable for removal/remediation of hazardous materials.
- Process and procedures required to eliminate exposure.
- Maintenance and control measures, personal protective equipment and work methods required to minimise hazardous material risk including potential contamination of other areas.
- Control levels and exposure standards for hazardous materials.
- The purpose of any air monitoring or health surveillance undertaken.

10. Signage

NSW Work Health and Safety Regulation 2017 R422, R424, R427 and R429 requires that the person with the management control of the workplace to identify asbestos containing materials and the asbestos material that has been identified to date must be labelled and ensure that it complies with the Australian Standard 1319: Safety Signs for the Occupational Environment; signage should be similar to the label detailed below.

Signage should also be placed at the entry points to the building/plant.





11. Review

This Asbestos Management Plan must be reviewed whenever the Asbestos Register is reviewed. These reviews must assess all asbestos material management processes and their effectiveness.

The site Asbestos Register, including any risk assessments, must be reviewed every 5 years from date of creation or earlier where a risk assessment indicates the need or ACM has been removed and/or disturbed. Visual inspection of asbestos materials must be included in any review of the Asbestos Register.

Risk assessments should be reviewed regularly in accordance with pertinent legislation and regulation and whenever:

- there is evidence that a risk assessment is no longer valid;
- there is evidence that control measures are not effective;
- a significant change is proposed for the workplace or work practices/procedures relevant to the risk assessment;
- there is a change in the condition of the ACM; and
- ACM has been removed, enclosed or sealed.

Only competent persons may perform and revise risk assessments. A provisional timetable for review of risk assessments, the site Asbestos Register and Management Plan is outlined within document control section of this Asbestos Management Plan.


12. Emergency Procedures

If known or suspected ACM is damaged or otherwise disturbed, the procedure in **Figure 1** (over the page) must be followed in full.

In summary, the procedure is:

- stop work immediately,
- follow the chart,
- minimise the spread of contamination to other areas,
- keep risk of exposure as low as possible, and
- Immediately report incident to Council on 4780 5000.

Figure 1 Emergency Procedures Chart

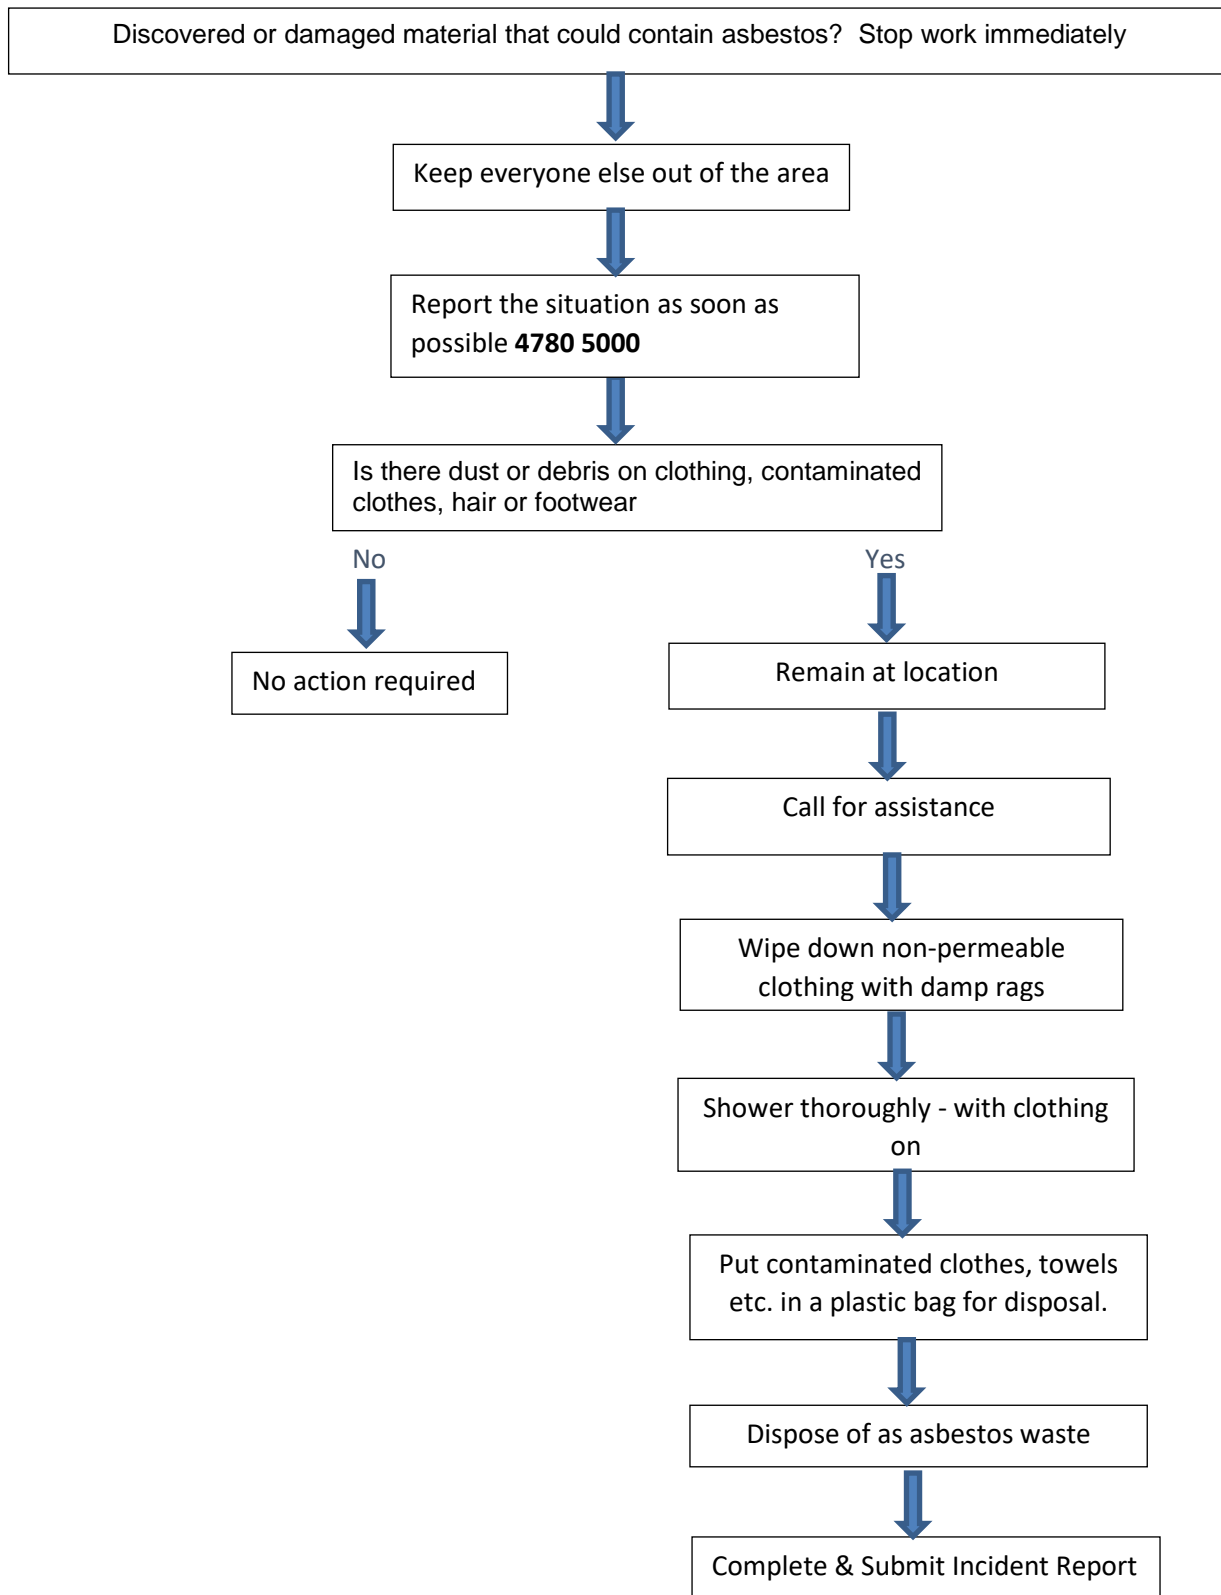



13. Legislation, Codes & Standards

Workplace Health and Safety in NSW is regulated under the *Work Health and Safety Act 2011* and *Work Health and Safety Regulations 2017*. In addition a are number of related Codes of Practice, Standards and guidelines pertain to the management of asbestos materials.

Legislation

- Work Health and Safety (WHS) Act NSW (2011 [reviewed 2016]).
- WHS Regulation NSW 2017.
- Ozone Protection and Synthetic Greenhouse Gas Management Regulations NSW (1996 [amended 2016]).
- NSW Protection of the Environment Operations Act (1997).

Code of Practice

- Safework NSW (2019), How to Manage and Control Asbestos in the Workplace: Code of Practice.
- Safework NSW (2019), How to Safely Remove Asbestos: Code of Practice.

Standards

- AS/NZS4361.2 (2017) Guide to Lead Paint Management, Part 2: Residential and Commercial Buildings.
- National Occupational Health and Safety Commission (NOHSC):1012 (1994), National Standard for the Control of Inorganic Lead at Work.
- NOHSC: 1004 (1990), National Standard for Synthetic Mineral Fibres.
- AS 1319 (1994). Safety Signs for the Occupational Environment.
- AS/New Zealand Standard (NZS) 1716 (2003), Respiratory Protective Devices.
- AS/NZS 1715 (2009), Selection, Use and Maintenance of Respiratory Protective Devices.
- The Australian and New Zealand Environment Conservation Council (ANZECC, 1996), Polychlorinated Biphenyls Management Plan.
- Australian Commonwealth Government. (2015). Standard for the Uniform Scheduling of Medicines and Poisons, Section Seven/Appendix I: Paints or Tinters.
- AIOH Exposure Standards Committee (2016), Synthetic Mineral Fibres (SMF) and Occupational Hygiene Issues (3rd Edition).
- Australian Standard (AS) 4964 (2004) Method for the qualitative identification of asbestos in bulk samples.

14. Terms & Definitions

| Term | Definition |
|---|---|
| Airborne asbestos | Fibres of asbestos small enough to be made airborne. |
| AMP | Asbestos Management Plan |
| Asbestos | The asbestiform varieties of mineral silicates belonging to the serpentine or amphibole groups of rock-forming minerals, including actinolite asbestos, grunerite (or amosite) asbestos (brown), anthophyllite asbestos, chrysotile asbestos (white), crocidolite asbestos (blue) and tremolite asbestos. |
| Asbestos Containing Material (ACM) | Any material or product containing asbestos. |
| Asbestos-Contaminated Dust or Debris (ACD) | Dust or debris that has settled within a workplace and is (or assumed to be) contaminated with asbestos. |
| Asbestos-Related work | Any work involving the removal or other disturbance of ACM |
| Asbestos Removalist | A person conducting a business or undertaking who carries out asbestos removal work. |
| Asbestos Removal Work | Work involving the removal of asbestos containing materials (ACM). |
| BMCC | Blue Mountains City Council |
| Competent Person | A person who has acquired, through training, qualification or experience, the knowledge and skills to carry out specific tasks. |
| Duty Holder | A person who has a duty in relation to a matter under the NSW Work Health and Safety Act 2011. |
| In-Situ Asbestos | Asbestos or ACM fixed or installed in a structure, equipment or plant but does not include naturally occurring asbestos. |
| Friable Asbestos | ACM that may readily be crumbled, pulverised or reduced to a form where fibres may be freely released, |
| Licensed Asbestos Removal Work | Asbestos removal work carried out by a Class A or Class B licensed asbestos removalist. |
| Non-Friable Asbestos | Material containing asbestos that is not friable asbestos, including material containing asbestos fibres reinforced with a bonding compound. |
| NSW WHS Regulations | <i>NSW Work Health and Safety Regulations 2011.</i> |
| PPE | Personal Protective Equipment |
| RPE | Respiratory Protective Equipment |
| RTO | Registered Training Organisation |
| SOP | Safe Operating Practice |
| Worker | People conducting work associated with council including employees, contractors, consultants, and volunteers (as defined by clause 7 of the <i>NSW WHS Act 2011</i>). |



| Term | Definition |
|------|------------------------|
| WHS | Work Health and Safety |